


ARIES ROUND HEATER - Installation Diagram for Separate Control (NS)

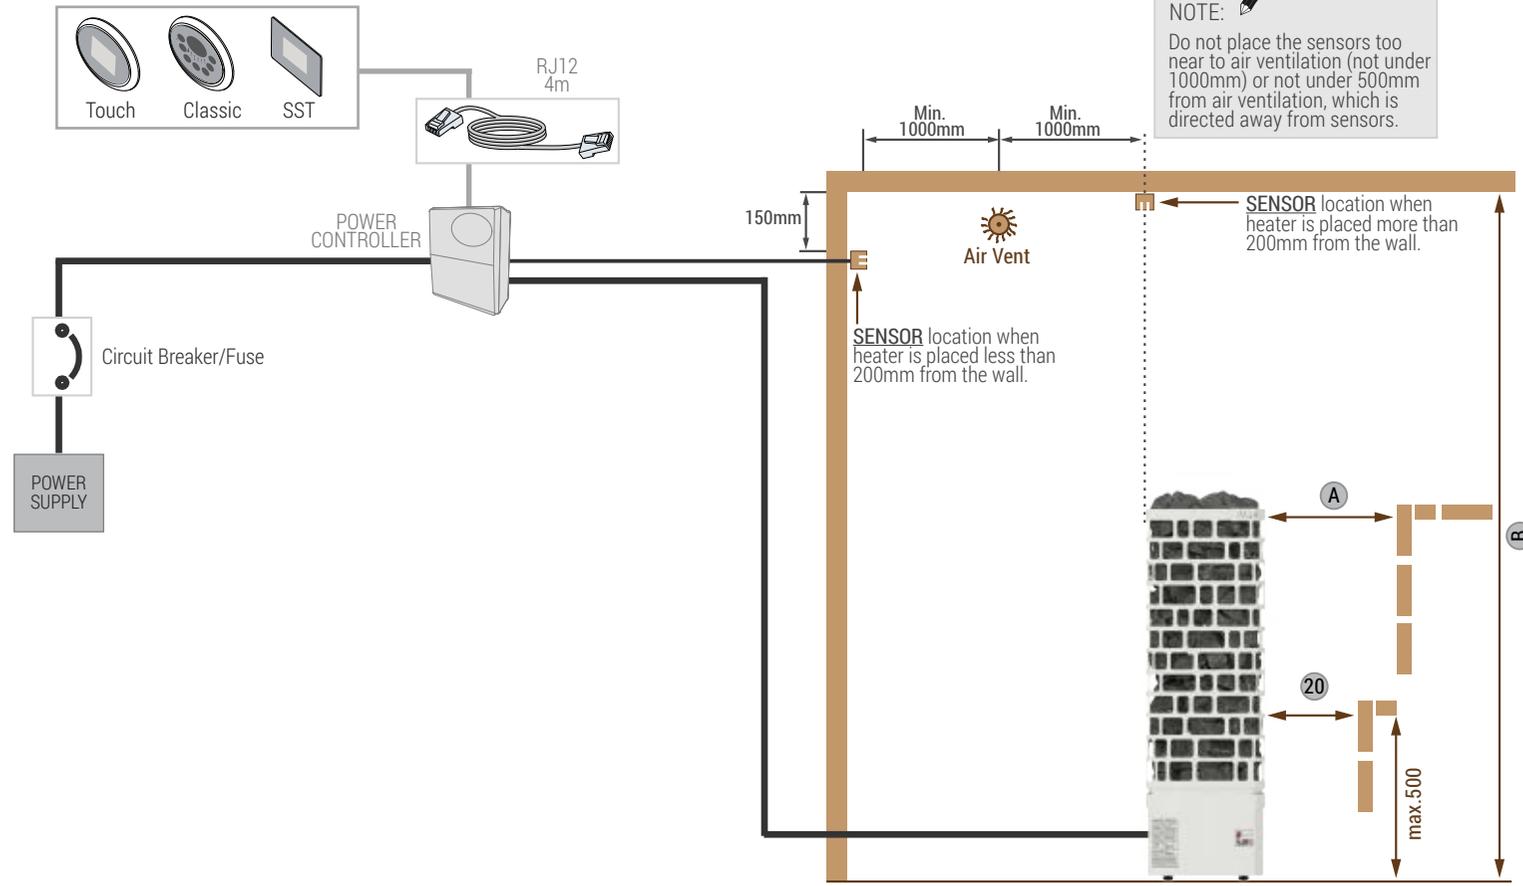

NOTE:
Do not place the sensors too near to air ventilation (not under 1000mm) or not under 500mm from air ventilation, which is directed away from sensors.

Minimum Safety Distances


	A	B
ARI3-45NS	100	1900
ARI3-60NS	100	1900
ARI3-75NS	100	1900
ARI3-90NS	100	1900
ARI6-90NS	100	1900
ARI6-105NS	100	1900
ARI6-120NS	125	2100
ARI6-150NS	125	2100
ARI6-180NS	150	2100



ARIES ROUND HEATER- Installation Diagram for Built Control (NB)

Minimum Safety Distances

	A	B
ARI3-45NB	100	1900
ARI3-60NB	100	1900
ARI3-75NB	100	1900
ARI3-90NB	100	1900
ARI6-90NB	100	1900

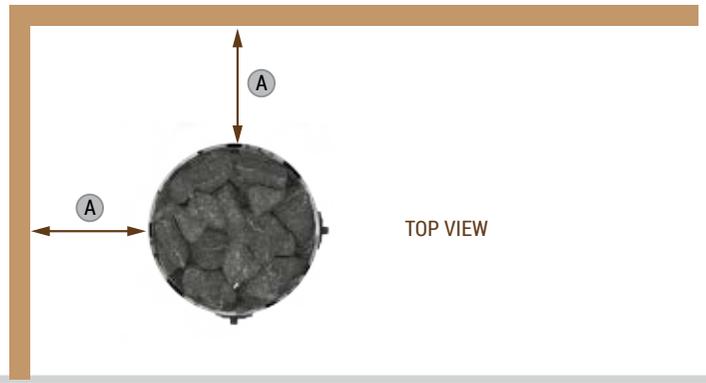

TOP VIEW